

1718 W. Fullerton Chicago, IL 60614 Ph: 773.770.1196 • Fax: 773.883.6128 www.pureedgelighting.com • info@pureedgelighting.com © 2016 PureEdge Lighting. All Rights Reserved.


Installation Instructions for 12 Volt DC 60 Watt Power Supply




GENERAL INFORMATION	IMPORTANT SAFETY INSTRUCTIONS		
	THE ORTANT SALETT INSTRUCTIONS		
 - RISK OF FIRE: This product must be installed by a qualified electrician. Turn the power to the electrical box off 	- Do not install this power supply in a wet location.		
during installation. Read the "Important Safety Instructions " before installation.	- To reduce the risk of the system overheating and possibly causing a fire, make sure all the connections are tight.		
- NOTE: To avoid overheating the power supply, install it in a ventilated remote location where air flows. Maintain proper spacing among power supplies when multiple power supplies are installed in the same remote location.	- Do not install *LED fixture closer than three inches or as specified in the *LED fixture installation instructions to curtains or similarly combustible materials. Keep insulation at least 3" away from the enclosure.		
 This product is not suitable for wet locations. It is approved for the use at any height above the finished floor. 	- Turn the electrical power off before modifying the lighting system in any way.		
 A typical installation is shown. Specific installation must be in accordance with the local electrical codes. 	- For dimming options refer to EDGELIGHTING.COM.		
	* See LED fixture installation instructions for proper		
 TO REDUCE RISK OF FIRE, it is important to wire the power supply for the system as described in this installation instruction. 	placement.		
- Load the power supply to MAXIMUM 60 Watts.			
SAVE THESE INSTRUCTIONS!			


Install the Power Supply


A PHILLIPS	 Loosen and remove the four Phillips screws on sides of
SCREW(4x)	the power supply to remove the cover. Secure the power supply case to the desired location with
COYER	two #6 screws provided.

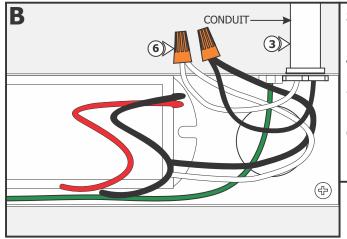

- **3:** Install a conduit and power wires from the panel to the power supply.
- 4: **<u>DO NOT</u>** connect the power wires to the panel at this time.
- **5:** Ground the power supply housing in accordance with local electrical codes.
- **6:** Connect the 120 volt wires coming from power supply port the hot and neutral 120 VAC power line wires respectively with wire nuts.

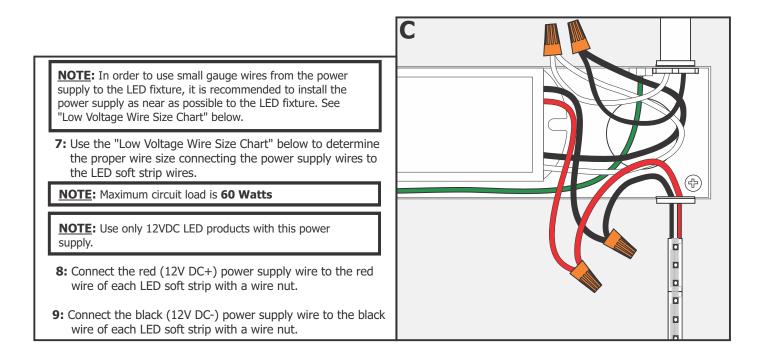

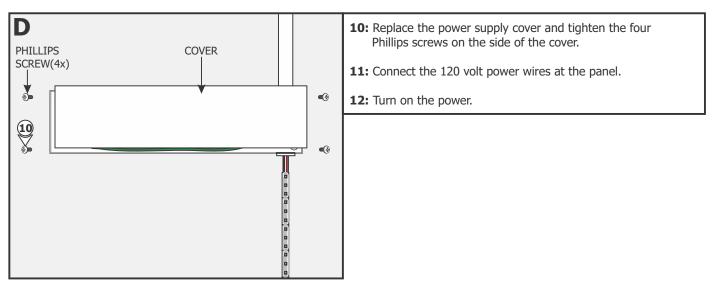

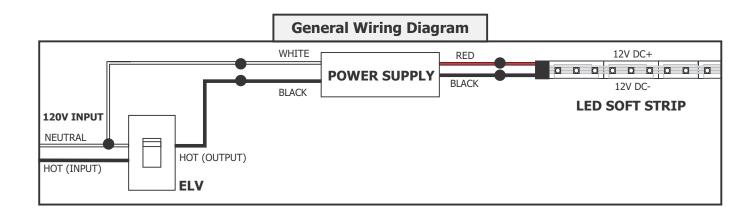

	LOW VOLTAGE WIRE SIZE CHART			
TRANSFORMER WATTAGE	WIRE SIZE UP TO 13 FT	WIRE SIZE FOR 14-20 FT	WIRE SIZE FOR 21-34 FT	WIRE SIZE FOR 35-52 FT
60 WATT 12 Volt	#14 GA	#12 GA	#10 GA	#8 GA