


4.4 PROTRUDING OBJECTS

4.4.1 General

Objects projecting from walls (for example, telephones) with their leading edges between 27 in and 80 in above the finished floor shall protrude no more than 4 in into walks, halls, corridors, passageways, or aisles (see drawing). Objects mounted with their leading edges at or below 27 in above the finished floor may protrude any amount. Free-standing objects mounted on posts or pylons may overhang 12 in maximum from 27 in to 80 in above the ground or finished floor. Protruding objects shall not reduce the clear width of an accessible route or maneuvering space.

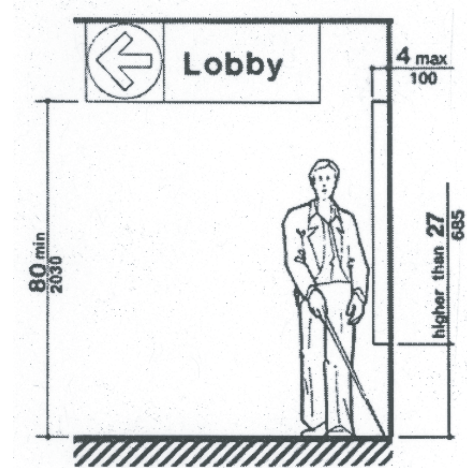

4.4.2 Head Room

Walks, halls, corridors, passageways, aisles, or other circulation spaces shall have 80 in minimum clear head room. If vertical clearance of an area adjoining an accessible route is reduced to less than 80 in, a barrier to warn blind or visually impaired persons shall be provided.