

LED Product Information and Warnings

Important

- **Always disconnect the power before installing or replacing bulbs and before cleaning or other maintenance.**
- **Consult a qualified, licensed electrician to ensure correct branch circuit conductor.**
- Please read all included assembly instructions and warnings carefully before installation. Contact Customer Service if you have any questions or concerns. Before installation, please confirm that the fixture is compatible with your supply voltage and dimming system, if present.
- LEDs are highly sensitive electronic devices, and must be treated with care. Do not open any factory sealed compartments, and avoid touching the LEDs with your hands or any object.
- Although all our fixtures are equipped with protective devices, LED fixtures are vulnerable to power surges and supply variations. Do not install LED fixtures on the same circuit as any motors, appliances, or HVAC systems.
- Do not remove or bypass any LED Driver or Transformer that is provided with the fixture, and do not replace or substitute with another power supply.
- Remote LED Driver or Transformer installation must be done by a licensed electrician and in accordance with local codes. Remote installations should be in an accessible location, as close to the fixture as possible.
- Fixtures must be wired in parallel on independent leads; do not "daisy chain" multiple fixtures together or wire them in series.
- All factory-made splices and connections must remain intact. LED circuits are carefully designed and built, and improper connections may damage the fixture.
- The ends of coaxial pendant cords have been precisely stripped and split at the factory and must not be field cut. Excess cord or cable should be neatly coiled and reserved in the fixture canopy.
- Any mounting hardware is provided for your convenience and should be used with discretion. Always use the appropriate hardware for the mounting surface.

October 15, 2018

Assembly Instructions


2810-3, 2810-4, 2810-6, 2810-8

INSTRUCTIONS D'INSTALLATION

Thin-Line Series - 3' LED One-Sided Wall Bar, 4' LED One-Sided Wall Bar, 6' LED One-Sided Wall Bar, 8' LED One-Sided Wall Bar


Important

- Always disconnect the power before installing and before cleaning or other maintenance.
- Consult a qualified, licensed electrician to ensure correct branch circuit conductor.
Consulter un électricien qualifié pour vous assurer que les conducteurs de la dérivation sont adéquats.



2810-3

1. Shut off power to the outlet box.
2. The LED driver (A) must be installed in a remote and accessible location near the fixture in accordance with local electrical code (Fig. 1).
 - a. Connect the LED driver's live wire (black) to the live supply wire.
 - b. Connect the LED driver's neutral wire (white) to the neutral supply wire.
 - c. Connect the LED driver's positive (+) output wire to the necessary length of red wire (not included) to reach the fixture (B) location.
 - d. Connect the LED driver's negative (-) output wire to the necessary length of black wire (not included) to reach the fixture location.
3. Drill a small 1/4" hole (C) in the wall behind the fixture (B), and pull the low voltage wires through the wall.
4. Using the fixture (B) as a template, install mounting Allen screws (D) with the provided Allen key (E) and anchors (F). Do not tighten screws completely.
5. Pull the LED Driver's (A) positive (+) and negative (-) wires and route through the wire slot (G) on fixture (B).

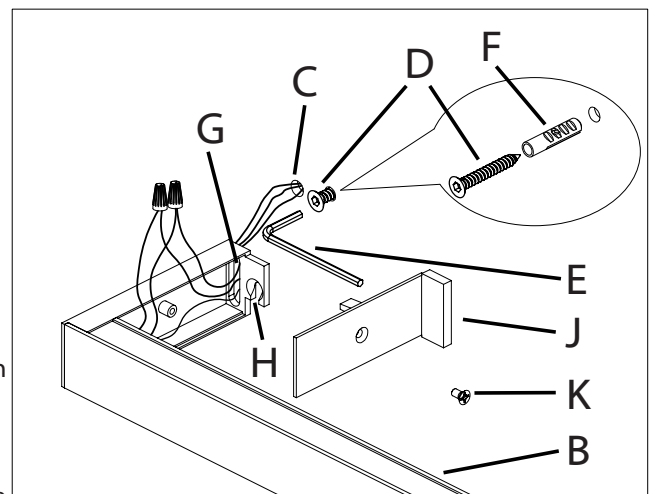

Detailed View

- Note:** Either end of the fixture can be connected to the driver. The unused input wires must be capped off.
6. Hang fixture (B) on the hooks (H), secure fixture by tightening mounting Allen screws (D) using the provided Allen Key (E).
 7. Make appropriate electrical connections using wire nuts:
 - a. Connect the positive (red) low voltage wire to the red fixture wire.
 - b. Connect the negative (black) low voltage wire to the black fixture wire.
 - c. Carefully place the connections in the fixture's (B) end.
 8. Slide in the covers (J) and secure with cover screws (K).
 9. Restore power to the outlet box.

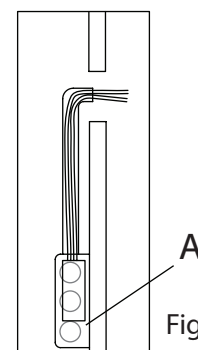





Fig. 1

2810-3 

2810-4 

2810-6 

2810-8 

Note

- These fixtures are dimmable with Electronic Low Voltage (Trailing-Edge) type dimmers and Incandescent (Leading-Edge) type dimmers. For best performance, we recommend using an Electronic Low Voltage Dimmer.

Care Instructions

- **Dusting:** Use a clean, dry cloth.
- **Cleaning:** To protect the finish, avoid any harsh abrasives or chemicals.

LED Product Information and Warnings

Important

- **Always disconnect the power before installing or replacing bulbs and before cleaning or other maintenance.**
- **Consult a qualified, licensed electrician to ensure correct branch circuit conductor.**
- Please read all included assembly instructions and warnings carefully before installation. Contact Customer Service if you have any questions or concerns. Before installation, please confirm that the fixture is compatible with your supply voltage and dimming system, if present.
- LEDs are highly sensitive electronic devices, and must be treated with care. Do not open any factory sealed compartments, and avoid touching the LEDs with your hands or any object.
- Although all our fixtures are equipped with protective devices, LED fixtures are vulnerable to power surges and supply variations. Do not install LED fixtures on the same circuit as any motors, appliances, or HVAC systems.
- Do not remove or bypass any LED Driver or Transformer that is provided with the fixture, and do not replace or substitute with another power supply.
- Remote LED Driver or Transformer installation must be done by a licensed electrician and in accordance with local codes. Remote installations should be in an accessible location, as close to the fixture as possible.
- Fixtures must be wired in parallel on independent leads; do not "daisy chain" multiple fixtures together or wire them in series.
- All factory-made splices and connections must remain intact. LED circuits are carefully designed and built, and improper connections may damage the fixture.
- The ends of coaxial pendant cords have been precisely stripped and split at the factory and must not be field cut. Excess cord or cable should be neatly coiled and reserved in the fixture canopy.
- Any mounting hardware is provided for your convenience and should be used with discretion. Always use the appropriate hardware for the mounting surface.

October 15, 2018

Assembly Instructions


INSTRUCTIONS D'INSTALLATION

2812-3, 2812-4, 2812-6

Thin-Line Series - 3' LED Two-Sided Wall Bar, 4' LED Two-Sided Wall Bar, 6' LED Two-Sided Wall Bar


Important

- Always disconnect the power before installing and before cleaning or other maintenance.
- Consult a qualified, licensed electrician to ensure correct branch circuit conductor.
Consulter un électricien qualifié pour vous assurer que les conducteurs de la dérivation sont adéquats.



2810-3

1. Shut off power to the outlet box.
2. The LED driver (A) must be installed in a remote and accessible location near the fixture in accordance with local electrical code (Fig. 1).
 - a. Connect the LED driver's live wire (black) to the live supply wire.
 - b. Connect the LED driver's neutral wire (white) to the neutral supply wire.
 - c. Connect the LED driver's positive (+) output wire to the necessary length of red wire (not included) to reach the fixture (B) location.
 - d. Connect the LED driver's negative (-) output wire to the necessary length of black wire (not included) to reach the fixture location.
 - e. Repeat for the second LED driver.
3. Using the fixture (B) as a template, drill a small 1/4" hole (C) in the wall behind the fixture at one end, and pull the low voltage wires from the first LED driver (A) through the wall. Repeat for the second LED driver at the other end.
4. Using the fixture (B) as a template, install mounting screws (D) with the provided Allen key (E) and anchors (F). Do not tighten screws completely.
5. Pull the LED Drivers' (A) positive (+) and negative (-) wires and route through the wire slots (G) on both ends of the fixture (B).
6. Hang fixture (B) on the hooks (H), secure fixture by tightening Allen mounting screws (D) using provided Allen key (E).
7. Make appropriate electrical connections using wire nuts:
 - a. Connect the positive (red) low voltage wire to the red fixture wire.
 - b. Connect the negative (black) low voltage wire to the black fixture wire.
 - c. Carefully place the connections in the fixture's (B) end.
 - d. Repeat on the other end of the fixture.
8. Slide in the covers (J) and secure with cover screws (K).
9. Restore power to the outlet box.

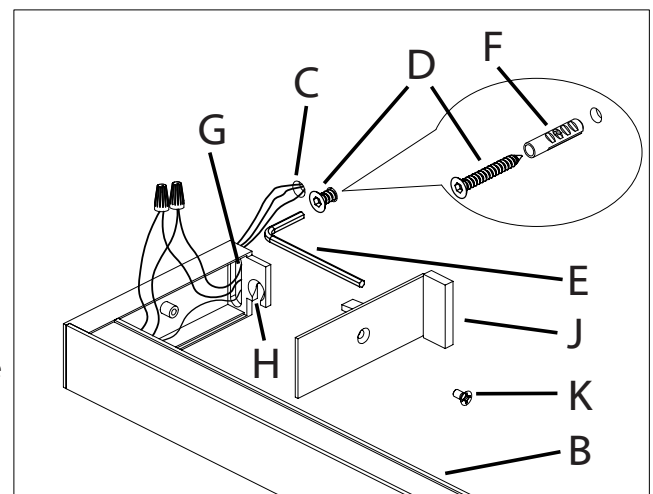

Detailed View

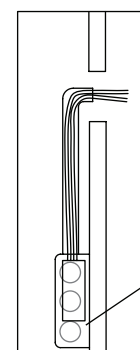


Fig. 1

2812-3

2812-4

2812-6

Note

- These fixtures are dimmable with Electronic Low Voltage (Trailing-Edge) type dimmers and Incandescent (Leading-Edge) type dimmers. For best performance, we recommend using an Electronic Low Voltage Dimmer.

Care Instructions

- **Dusting:** Use a clean, dry cloth.
- **Cleaning:** To protect the finish, avoid any harsh abrasives or chemicals.

LED Product Information and Warnings

Important

- **Always disconnect the power before installing or replacing bulbs and before cleaning or other maintenance.**
- **Consult a qualified, licensed electrician to ensure correct branch circuit conductor.**
- Please read all included assembly instructions and warnings carefully before installation. Contact Customer Service if you have any questions or concerns. Before installation, please confirm that the fixture is compatible with your supply voltage and dimming system, if present.
- LEDs are highly sensitive electronic devices, and must be treated with care. Do not open any factory sealed compartments, and avoid touching the LEDs with your hands or any object.
- Although all our fixtures are equipped with protective devices, LED fixtures are vulnerable to power surges and supply variations. Do not install LED fixtures on the same circuit as any motors, appliances, or HVAC systems.
- Do not remove or bypass any LED Driver or Transformer that is provided with the fixture, and do not replace or substitute with another power supply.
- Remote LED Driver or Transformer installation must be done by a licensed electrician and in accordance with local codes. Remote installations should be in an accessible location, as close to the fixture as possible.
- Fixtures must be wired in parallel on independent leads; do not "daisy chain" multiple fixtures together or wire them in series.
- All factory-made splices and connections must remain intact. LED circuits are carefully designed and built, and improper connections may damage the fixture.
- The ends of coaxial pendant cords have been precisely stripped and split at the factory and must not be field cut. Excess cord or cable should be neatly coiled and reserved in the fixture canopy.
- Any mounting hardware is provided for your convenience and should be used with discretion. Always use the appropriate hardware for the mounting surface.

January 2, 2018

Assembly Instructions


2814-3, 2814-4, 2814-6, 2814-8

INSTRUCTIONS D'INSTALLATION

Thin-Line Series - 3' LED Indirect Wall Bar, 4' LED Indirect Wall Bar, 6' LED Indirect Wall Bar, 8' LED Indirect Wall Bar


Important

- Always disconnect the power before installing and before cleaning or other maintenance.
- Consult a qualified, licensed electrician to ensure correct branch circuit conductor.
Consulter un électricien qualifié pour vous assurer que les conducteurs de la dérivation sont adéquats.



1. Shut off power to the outlet box.
2. The LED driver (A) must be installed in a remote and accessible location near the fixture in accordance with local electrical code (Fig. 1).
 - a. Connect the LED driver's live wire (black) to the live supply wire.
 - b. Connect the LED driver's neutral wire (white) to the neutral supply wire.
 - c. Connect the LED driver's positive (+) output wire (red) to the necessary length of red wire (not included) to reach the fixture (B) location.
 - d. Connect the LED driver's negative (-) output wire (black) to the necessary length of black wire (not included) to reach the fixture location.
3. Drill a small 1/4" hole (C) in the wall behind the fixture (B) and pull the low voltage wires through the wall.
4. Using the fixture (B) as a template, install mounting screws (D) with anchors (E). Do not tighten screws completely.
5. Pull the LED Driver's (A) positive (+) and negative (-) wires and route through the wire hole (F) on fixture (B).

Note: Either end of the fixture can be connected to the driver. The unused input wires must be capped off.
6. Hang fixture (B) on the hooks (G), secure fixture by tightening mounting screws (D).
7. Make appropriate electrical connections using wire nuts:
 - a. Connect the positive (red) low voltage wire to the red fixture wire.
 - b. Connect the negative (black) low voltage wire to the black fixture wire.
 - c. Carefully place the connections in the fixture's (B) end.
8. Slide in the covers (H) and secure with cover screws (J).
9. Restore power to the outlet box.

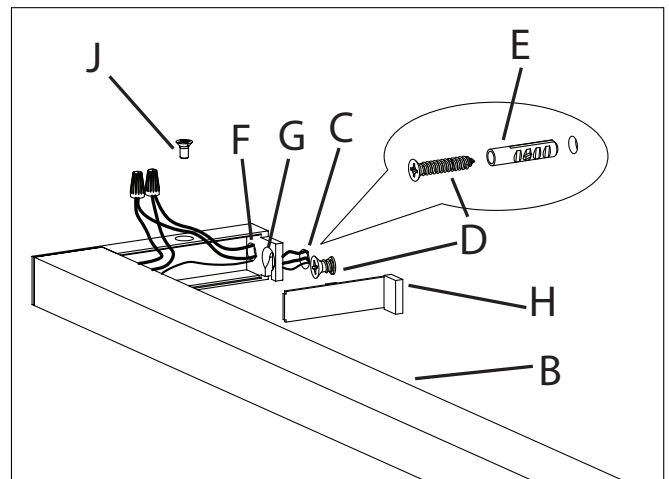

Detailed View




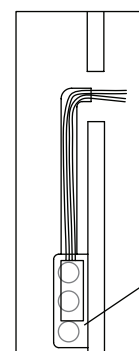


Fig. 1



Note

- These fixtures are dimmable with Electronic Low Voltage (Trailing-Edge) type dimmers and Incandescent (Leading-Edge) type dimmers. For best performance, we recommend using an Electronic Low Voltage Dimmer.

Care Instructions

- **Dusting:** Use a clean, dry cloth.
- **Cleaning:** To protect the finish, avoid any harsh abrasives or chemicals.